

SUBMITTAL DATA

VD-1310 Class III Leakage Resistance Control Dampers (Not for Outdoor Air Applications)

Standard Materials and Construction

Frame	3-1/2-inch x 1-inch x 13-gauge, galvanized steel, hat channel shaped, mechanically joined
Blades	16-gauge galvanized steel; 6-inch nominal width, 8-inch maximum width
Linkage	1/8-inch rolled steel, zinc plated, concealed in end channel of frame
Blade Pin	3/8-inch square steel, zinc plated
Bearings	Self-lubricating acetal or bronze
Side Seal	Self-compensating stainless steel
Blade Seal	Santoprene

Dimensional Data

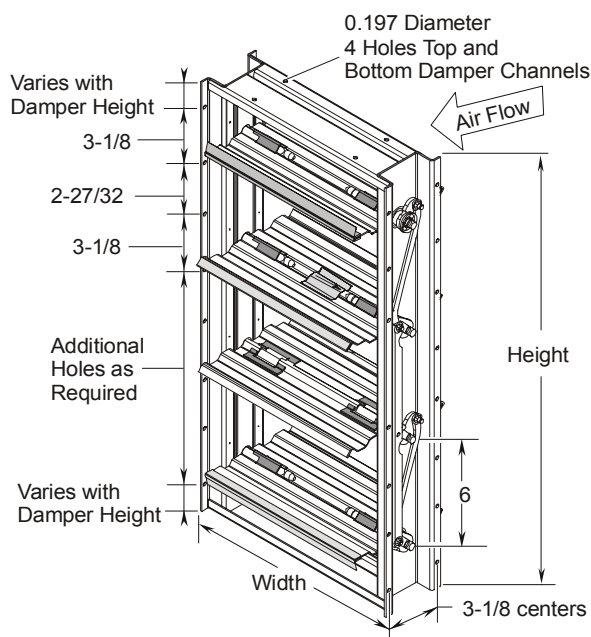


Figure 1: Damper Dimensions, inches

Table 1: Damper Dimensions

Size Limits	Width x Height, inches
Minimum	8 x 6
Maximum single panel	48 x 76
Multiple panel	192 x 228

Note: Actual size is 1/4-inch less than nominal.

Specifications

Furnish and install Johnson Controls® VD-1310 Class III volume dampers.

Frames are to be constructed of formed 13-gauge galvanized sheet steel, mechanically joined with linkage concealed in the side channels to eliminate noise and friction. Compressible spring stainless steel side seals and self-lubricating bearings shall also be provided.

Blades are to be constructed with formed 16-gauge galvanized steel. Damper blade width shall not exceed 8 inches and shall have seals. Blade rotation is to be parallel or opposed as shown on the schedules. Linkage to be included on both sides to assure proper torque distribution and ease actuator installation.

Performance shall be designed for normal shutoff in return air applications and tested in accordance with AMCA Standard 500. Leakage resistance for a 48-inch x 48-inch damper with seals shall not exceed 17 cubic feet per minute (cfm) per square foot at a 1-inch pressure differential, 45 cfm per square foot at a 4-inch pressure differential. Damper operating force at 4 inches differential shall not exceed 6 lb-in/sq ft. The damper must be rated to operate over a temperature range of -40°F to 200°F (-40°C to 93°C) standard and 40°F to 250°F (-40°C to 121°C) extended temperature.

Sizing shall be determined by the designer in accordance with accepted industry practices to ensure proper system performance. Blank off-plates and duct-to-damper transitions may be required.

Factory Options

- E Exact whole inch size, no undersizing
- F 1.5-inch L flange air entering side (Cannot be used with option G or H.)
- G 1.5-inch L flange air leaving side (Cannot be used with option F or H.)
- H Double flange (Cannot be used with option F or G.)
- J Jackshaft, field installed

Table 2: VD-1310 Control Damper Selector

	Ordering Code Number	V	V	N	-	w	w	w	x	h	h	h		
Application	V = Volume Control													
Blade Operation	O = Opposed P = Parallel													
Blade/Frame	V = 16-gauge/13-gauge Galvanized													
Bearing/Seal	S = Standard (Acetal/Santoprene) E = Extended (Bronze/Santoprene) H = High (Bronze/Silicone)													
Actuator	N = None													
Width	008 to 192 inches, 1-inch increments													
Height	006 to 228 inches, 1-inch increments													
Options (Limit 2)	See <i>Factory Options</i> for descriptions.													

Performance Data

Leakage Resistance - Fully Closed		17 cfm maximum at 1-inch static pressure for 48-inch x 48-inch damper 45 cfm maximum at 4-inch static pressure for 48-inch x 48-inch damper			
Operating Torque	0.5-inch static pressure and 100 fpm fully open approach velocity			3.25 lb-in /sq ft	
	1-inch static pressure and 1000 fpm fully open approach velocity			4.25 lb-in /sq ft	
Pressure Drop (inches WG) - Fully Open		1000 fpm	2000 fpm	3000 fpm	4000 fpm
24 inches x 24 inches		0.05	0.20	0.42	0.57
48 inches x 48 inches		0.03	0.10	0.25	0.45
Velocity and Pressure	Limits recommended to meet other performance specifications (not structural limits):	Damper Width:	12 inches	6000 fpm @ 6-inch static	
			36 inches	3000 fpm @ 4.5-inch static	
			48 inches	1500 fpm @ 3-inch static	
Temperature Rating	Normal Operating Conditions			-40°F to 200°F (-40°C to 93°C)	
	Extended (with bronze bearings and silicone seals)			-40°F to 250°F (-40°C to 121°C)	
Approximate Weight		5 pounds/square foot (2.7 kg/square foot)			

Dampers are tested at an AMCA Certified Laboratory using instrumentation and procedures in accordance with AMCA Standard No. 500, Test Methods for Louvers, Dampers, and Shutters.

All dampers are built to order and cannot be returned due to improper ordering. If a damper fails within the 3-year warranty period, the factory will determine if the damper is to be returned.

For application at conditions beyond these specifications, consult the local Johnson Controls representative. Johnson Controls, Inc. shall not be liable for damages resulting from misapplication or misuse of its products.

**JOHNSON
CONTROLS**
Controls Group
507 E. Michigan Street
P.O. Box 423
Milwaukee, WI 53201



www.johnsoncontrols.com
Printed in U.S.A.